bio-micro

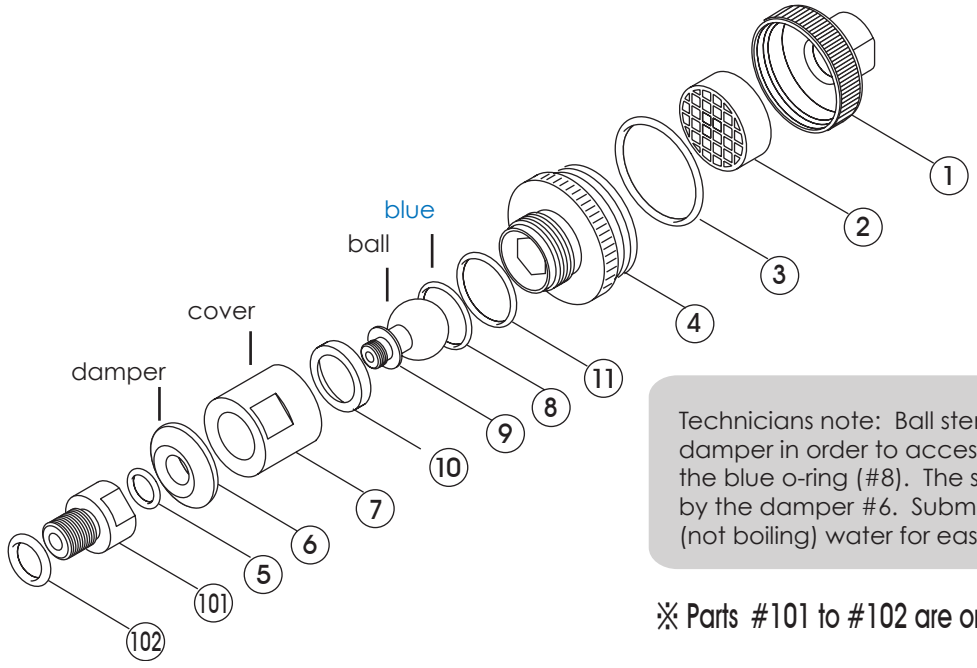

Technicians note: Ball stem must be separated from damper in order to access and properly exchange the blue o-ring (#8). The stem of #9 is held in cover by the damper #6. Submerge cover section in hot (not boiling) water for easier removal of damper.

※ Parts #101 to #102 are only used in 1/2 inch port units.

No.	Code	Description
1a	3120200034	3/8 INCH CAP FOR BIO-MICRO
1b	3120200041	1/2 INCH CAP FOR BIO-MICRO
2	1120280004	MESH CHARCOAL FILTER FOR B/F & A-107,110
3	3993592023	O-RING ARP-023/HS75
4	3120200025	BASE FOR BIO-MICRO
5	3993592011	O-RING ARP-011/HS75 (REGULATER & B.C)
6	3123080001	DAMPER FROM '04
7	3120200016	COVER : MBCR-3 C3601B FOR B.F
8	3993393517	O-RING S-16/HS50 FOR REGULATOR
9	3120200015	BALL : MBCR-3 C6783B FOR B.F
10	3120200018	BALL RECEIVER : WT POM FOR B.F
11	3993393518	O-RING S-18/HS70 FOR REGULATOR
101	1129800013	ADAPTER FOR BIO-MICRO